











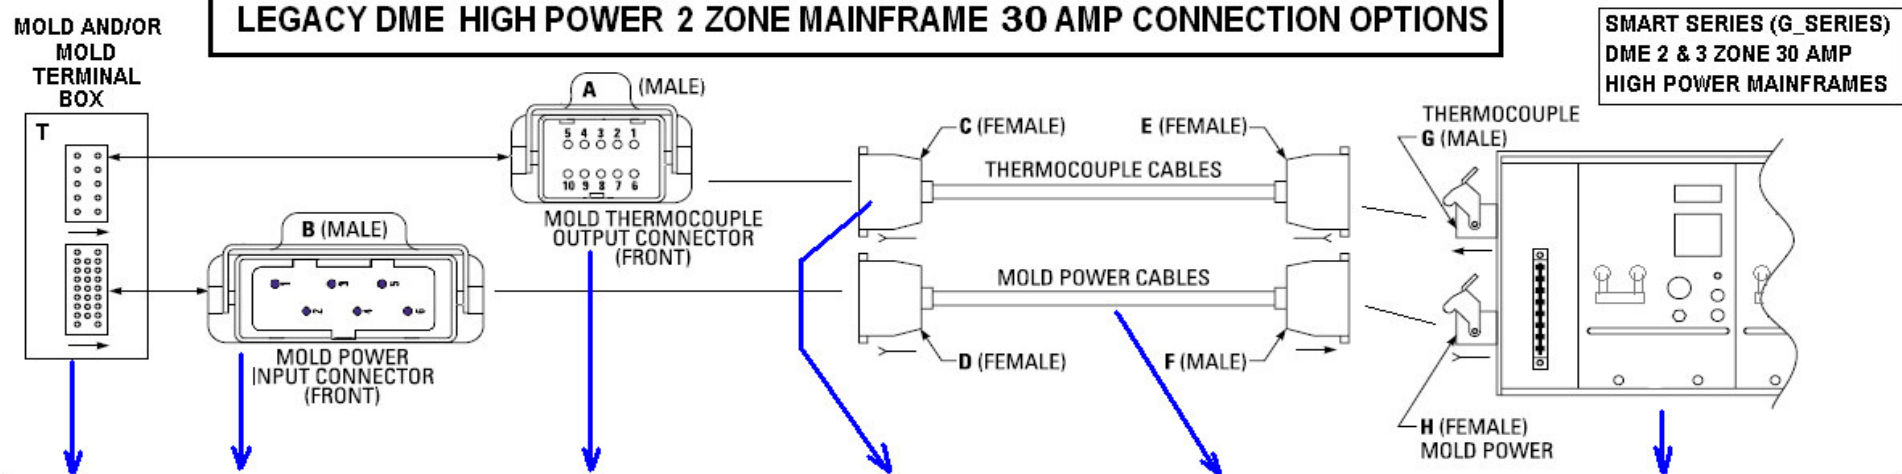






# LEGACY DME HIGH POWER 2 ZONE MAINFRAME 30 AMP CONNECTION OPTIONS

SMART SERIES (G\_SERIES)  
DME 2 & 3 ZONE 30 AMP  
HIGH POWER MAINFRAMES



T=MOLD TERMINAL BOX	B= MOLD POWER CONNECTOR	A=MOLD THERMOCOUPLE CONNECTOR	CE=J TYPE THERMOCOUPLE CABLE	DF=MOLD POWER CABLE	DME 30 AMP HIGH POWER MAINFRAMES - CONNECTORS G & H ARE THE SAME FOR ALL 2 & 3 ZONE FRAMES
<div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;">MOUNT DIRECTLY ON THE MOLD</div> <p style="text-align: center;">- OR -</p> <p style="text-align: center;">↓</p>	 <b>PICH23G</b> 6" LEADS 10AWG WIRE SCREW TERMINALS	 <b>MTC 5 G</b> SCREW TERMINALS	 <b>TC 5 C10G</b> 10 FOOT CABLE	 <b>MPCH23C10G</b> 10 FOOT CABLE	 <b>MFHP2G</b> 50 AMP 3-phase circuit breaker HIGH POWER 2 ZONE MAINFRAME
INDIVIDUAL MOLD TERMINAL BOX	 <b>PICH23TBG</b>	 <b>MTC5TBG</b>	 <b>TC 5 C20G</b> 20 FOOT CABLE	 <b>MPCH23C20G</b> 20 FOOT CABLE	 <b>MFHP2G-CV</b> 2 ZONE MAINFRAME WITH CURRENT VOLTAGE MONITOR CURRENT TRANSFORMERS ON EACH ZONE
COMBINATION MOLD TERMINAL BOX	 <b>PTCH23G</b>		 <b>TC 5 C20G</b> 20 FOOT CABLE	 <b>MPCH23C20G</b> 20 FOOT CABLE	 <b>MFCHP2G (FOR EXT. ALARM &amp; TAS)</b> 2 ZONE MAINFRAME WITH COMMUNICATION STRIP INSTALLED OUTER ZONES FOR TAS COMMUNICATION CONNECTORS
					 <b>MFCHP2G-CV</b> 2 ZONE MAINFRAME WITH CURRENT VOLT MONITOR AND COMMUNICATIONS
					 <b>MFCHPT2G</b> 2 ZONE MAINFRAME WITH MFTA-205 CIRCUIT BREAKER ALARM OUT & COMMUNICATIONS STRIP