












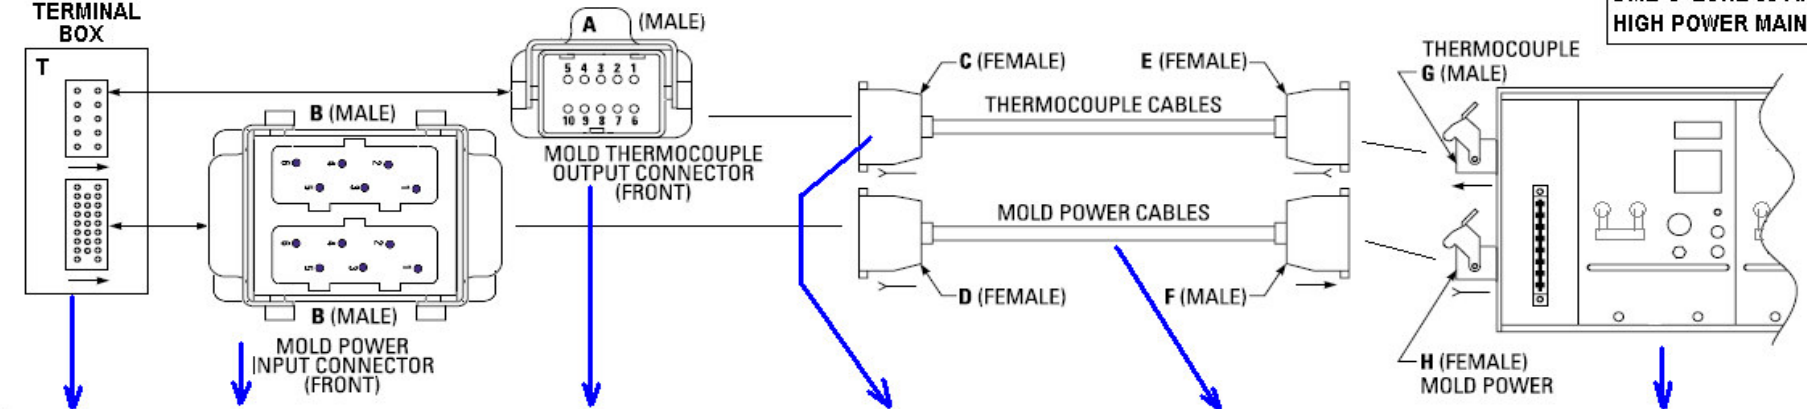



LEGACY DME HIGH POWER 5 ZONE MAINFRAME 30 AMP CONNECTION OPTIONS

SMART SERIES (G_SERIES)
DME 5 ZONE 30 AMP
HIGH POWER MAINFRAMES



T=MOLD TERMINAL BOX	B= MOLD POWER CONNECTOR	A=MOLD THERMOCOUPLE CONNECTOR	CE=J TYPE THERMOCOUPLE CABLE	DF=MOLD POWER CABLE	DME 30 AMP HIGH POWER MAINFRAMES - CONNECTORS G & H ARE THE SAME FOR ALL 5 ZONE FRAMES
<p>MOUNT DIRECTLY ON THE MOLD</p> <p>- OR -</p> <p>↓</p>	<p>PICH5G</p>  <p>6" LEADS 10AWG WIRE SCREW TERMINALS</p>	<p>MTC 5 G</p>  <p>SCREW TERMINALS</p>	 <p>TC 5 C10G</p>  <p>10 FOOT CABLE</p>	<p>MPCH5C10G</p>  <p>10 FOOT CABLE</p>	<p>MFHP5G</p>  <p>70 AMP 3-phase circuit breaker</p> <p>HIGH POWER 5 ZONE MAINFRAME</p>
	<p>INDIVIDUAL MOLD TERMINAL BOX</p> <p>PICH5TBG</p> 	<p>MTC5TBG</p> 	<p>TC 5 C20G</p>  <p>20 FOOT CABLE</p>	<p>MPCH5C20G</p>  <p>20 FOOT CABLE</p>	<p>MFHP5G-CV</p>  <p>5 ZONE MAINFRAME WITH CURRENT VOLTAGE MONITOR CURRENT TRANSFORMERS ON EACH ZONE</p> <p>MFCHP5G (FOR EXT. ALARM & TAS)</p>  <p>COMMUNICATION CONNECTORS</p> <p>5 ZONE MAINFRAME WITH COMMUNICATION STRIP INSTALLED</p>
<p>COMBINATION MOLD TERMINAL BOX</p> <p>PTCH5TBG</p> 					<p>MFCHP5G-CV</p> <p>5 ZONE MAINFRAME WITH CURRENT VOLT MONITOR AND COMMUNICATIONS</p> <p>MFCHPT5G</p>  <p>5 ZONE MAINFRAME WITH MFTA-205 CIRCUIT BREAKER ALARM OUT & COMMUNICATIONS STRIP</p>